

CARES Technical Approval Report TA1-B 5038



HY-TEN
REINFORCEMENT

Hy-Ten
HT(S) Welded Couplers

Assessment of the
Hy-Ten HT(S) Welded
Coupler Product and
Quality System for
Production



5038

Electronic Copy www.ukcares.com

Product

Hy-Ten HT(S) Welded Couplers for Reinforcing Steel.

Produced by:

Hy-Ten Reinforcement Co (Newark)
Newark Storage Industrial Estate
Bowbridge Road
Newark
Nottinghamshire NG24 4EQ
UK

Tel: 01636 700418 Fax: 01636 605179

1 Product Summary

Hy-Ten HT(S) Welded Couplers in the size range 12mm - 32mm are for the mechanical connection of deformed high yield carbon steel bars for the reinforcement of concrete complying with the requirements of BS4449 Grade B500B and B500C.

1.1 Scope of Application

Hy-Ten HT(S) Welded Couplers in the size range 12mm - 32mm have been evaluated for use as follows:

- a) 12mm - 32mm HT(S) Welded couplers for static BS8110 applications in tension only in accordance with CARES Appendix TA1-B.

1.2 Design Considerations

BS 8110 Clause 3.12.8.9 *Laps and Joints* states "Connections transferring stress may be lapped, welded or joined with mechanical devices. They should be placed, if possible, away from points of high stress and should preferably be staggered". However, BS 8110 Clause 3.12.8.16.2 *Bars in tension* states "The only acceptable form of full-strength butt joint for a bar in tension comprises a mechanical coupler" satisfying specified slip and tensile strength criteria.

The specified cover for fire resistance and durability should be provided to the coupler sleeve. All couplers have been designed with controlled mechanical properties to be compatible with reinforcing bars complying with BS4449 Grade B500B and B500C.



1.3 Conclusion

It is the opinion of CARES that Hy-Ten HT(S) Welded Couplers in the size range 12mm - 32mm are satisfactory for use within the limits stated in paragraph 1.1 when applied and used in accordance with the manufacturer's instructions and the requirements of this certificate.

A handwritten signature in blue ink, appearing to read 'B. Bowsher'.

B. Bowsher
Executive Director

January 2012



2 Technical Specification


2.1 General

The function of HT(S) Welded Couplers is to connect deformed steel reinforcing bars complying with BS 4449 Grade B500B and B500C and thereby create structural continuity of the reinforcing system.

2.2 HT(S) Welded Couplers

The HT(S) Welded Coupler is a system providing a mechanical connection of deformed Grade B500B and B500C high yield carbon steel bars for the reinforcement of concrete, complying with the tensile properties of BS4449.

HT(S) Welded Coupler

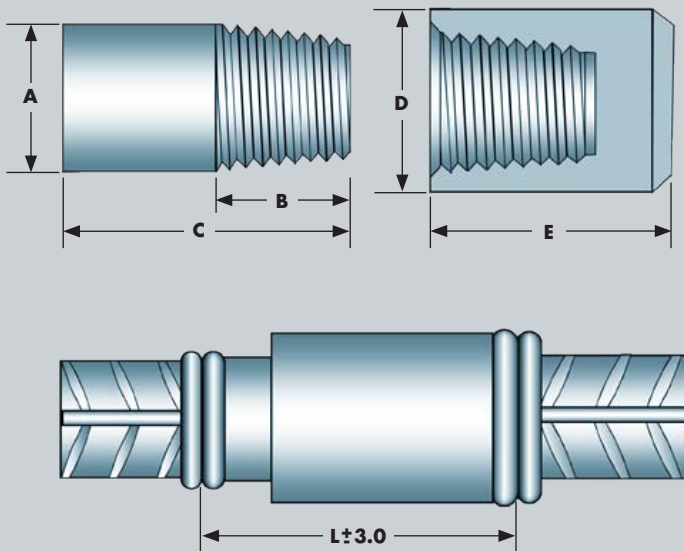

Coupler Ref	Bar Dia	A	B	C	D	E	L
HT(S)12	12	13	13	35	18	32	50
HT(S)16	16	16	17	42	22	36	50
HT(S)20	20	19	20	45	25	40	50
HT(S)25	25	25	25	55	34	50	65
HT(S)32	32	32	32	63	42	63	80

3 Product Performance and Characteristics

3.1 Material Properties

Full destructive tests have been carried out to demonstrate compliance with the performance requirements defined in CARES Appendix TA1-B when used with reinforcing bars to BS4449 Grade B500B and B500C:

CARES APPENDIX TA1-B tensile strength requirements

- Permanent deformation is less than 0.10mm after loading to $0.65f_y$ in tension with grade B500B reinforcement.
- 99% characteristic tensile strength is greater than 540 MPa with grade B500B reinforcement.
- Permanent deformation is less than 0.10mm after loading to $0.65f_y$ in tension with grade B500C reinforcement.
- 99% characteristic tensile strength is greater than 575 MPa with grade B500C reinforcement.



4 Installation


The HT(S) coupler is always delivered to site welded to the appropriate re-bar. The formation of the joint is achieved by screwing the two sections together, ie male and female elements.

The joint should always be tightened by the use of a wrench, until there is no further movement available between the two sections.




HT(S) Coupler Machine

Coupler Installation

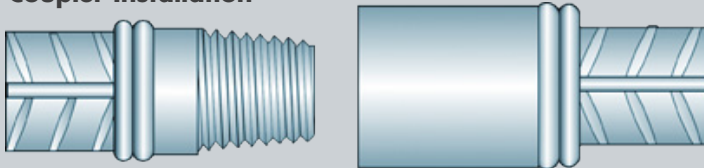

1 The two sections of the joint are brought together

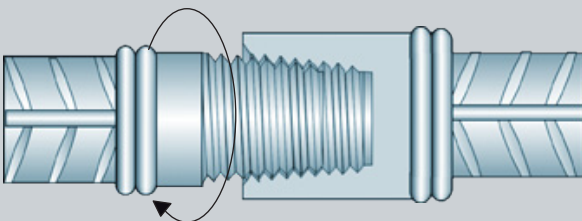

2 The joint is then screwed together using a wrench



3 Finished joint tightened with a wrench until no further movement between sections



5 Safety Considerations

The friction welding of the couplers is done at the Hy-Ten factory in Newark. The couplers are delivered to the factory, packaged in 20kg boxes. A full risk assessment has been undertaken by Hy-Ten for this manufacturing process.



On site, the usual safety precautions should be followed when handling re-bar and the use of gloves and other relevant PPE is always advised.

6 Product Testing and Evaluation

HT(S) Welded Couplers have been tested to satisfy the requirements of CARES Appendix TA1-B for Couplers with reinforcing bars to BS4449 Grade B500B and B500C. The testing comprised the following elements:

- Tensile Strength
- Permanent Deformation

The products are subject to a programme of periodic testing to ensure that they remain within the performance limits of this technical approval.

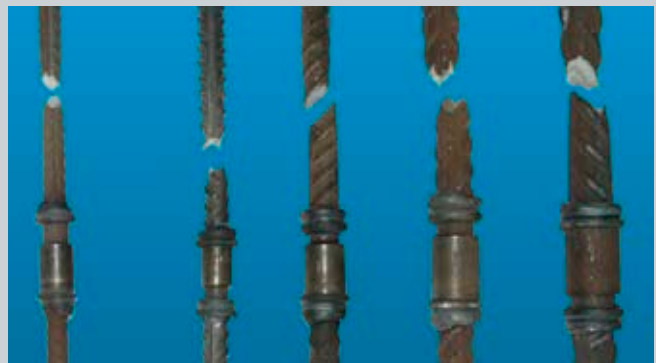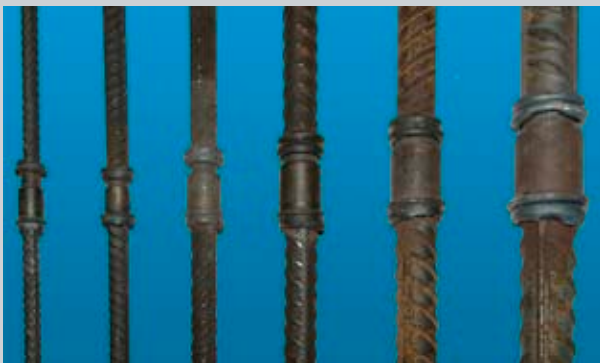

7 Quality Assurance

HT(S) Welded Couplers are produced under an ISO9001 quality management system certified by CARES. The quality management system scheme monitors the production of the couplers and ensures that materials and geometry remain within the limits of this technical approval.

8 Building Regulations

8.1 The Building Regulations (England and Wales)

Structure, Approved Document A

HT(S) Welded Couplers, when used in BS8110 based designs using the data contained within this technical approval, satisfy the relevant requirements of The Building Regulations (England and Wales), Approved Document A.

Materials and Workmanship, Approved Document, to support regulation 7

This technical approval gives assurance that the HT(S) Welded Couplers comply with the material requirements of BS8110.

8.2 The Building Regulations (Northern Ireland)

Part B, Materials and Workmanship

This technical approval gives assurance that HT(S) Welded Couplers comply with the material requirements of BS8110 by virtue of regulation B3, *Deemed to satisfy provisions regarding the fitness of materials and workmanship*.

8.3 The Building Standards (Scotland) Regulations

Part B, Fitness of Materials

This technical approval gives assurance that HT(S) Welded Couplers comply with the material requirements of BS8110 by virtue of *Clause B2.1*.

Part C, Structure

HT(S) Welded Couplers, when used in BS8110 based designs using the data contained within this technical approval, satisfy the requirements of *The Building Standards (Scotland) Regulations 1990, Part C, C2.1 clause b. construction,ii*.



9 References

- BS 4449: 2005: Steel for the reinforcement of concrete - Weldable reinforcing steel - Bar, coil and decoiled product - Specification.
- BS8110: Part 1: 1997 (Revised 2005): Structural Use of Concrete, Code of Practice for Design and Construction.
- BS EN ISO 9001: 2008: Quality management systems - Requirements.
- CARES Appendix TA1-B; Quality and Operations Schedule for the Technical Approval of Couplers for Reinforcing Steel For BS8110 Applications for Static Tension or Static Compression.

10 Conditions

1. The quality of the materials and method of manufacture have been examined by CARES and found to be satisfactory. This Technical Approval will remain valid provided that:
 - a The product design and specification are unchanged.
 - b The materials and method of manufacture are unchanged.
 - c The manufacturer complies with CARES regulations for Technical Approvals.
 - d The manufacturer holds a valid CARES Certificate of Product Assessment.
 - e The product is installed and used as described in this report.
2. CARES make no representation as to the presence or absence of patent rights subsisting in the product and/or the legal right of Hy-Ten to market the product.
3. Any references to standards, codes or legislation are those which are in force at the date of this certificate.
4. Any recommendations relating to the safe use of this product are the minimum standards required when the product is used. These requirements do not purport to satisfy the requirements of the Health and Safety at Work etc Act 1974 or any other relevant safety legislation.
5. CARES does not accept any responsibility for any loss or injury arising as a direct or indirect result of the use of this product.
6. This Technical Approval Report should be read in conjunction with CARES Certificate of Product Assessment No 5038. Confirmation that this technical approval is current can be obtained from UK CARES.





Electronic Copy www.ukcares.com



UK CARES

Pembroke House
21 Pembroke Road
Sevenoaks
Kent TN13 1XR

Phone: +44(0)1732 450000
Fax: +44(0)1732 455917
E-mail: general@ukcares.com
URL: www.ukcares.com

**Independent Product Assessments
for the Construction Industry**

Copyright UK CARES ©